

ADVR-2300M

Universal Hybrid Analog-Digital Voltage Regulator Operation Manual



Hybrid Universal Analog / Digital 1 or 3 Phase 3.5 Amp Self Excited, Shunt, Auxiliary Winding, Harmonic Power or PMG Automatic Voltage Regulator Easy to Set-Up and Program Install Manual

Use with KUTAI IVT-1260 / IVT-2460 add-on module can boost generator motor starting capacity.



KUTAI ELECTRONICS INDUSTRY CO., LTD.

TEL : +886-7-8121771

FAX : +886-7-8121775

Website : www.kutai.com.tw

Headquarters : No.3, Ln. 201, Qianfu St., Qianzhen Dist., Kaohsiung City 80664, Taiwan

ISO 9001
ETC

SECTION 1 : SPECIFICATION

Sensing Input (E1, E2, E3) RMS Reading

Voltage	220 – 600 Vac, 1 phase / 3 phase DIP switch setting
	180 – 280 Vac @ 220 Vac
	330 – 515 Vac @ 380 / 440 Vac
	420 – 660 Vac @ 480 / 600 Vac
Frequency	50/60 Hz, DIP switch setting

Power Input (P1, P2)

Voltage	60 – 300 Vac, 1 phase 2 wire
Frequency	50 – 500 Hz

Auxiliary Input (P3, P4)

Voltage	40 – 300 Vac, 1 phase 2 wire
Frequency	40 – 500 Hz

Excitation Output (F+, F-)

110V 1 phase	Continuous	63 Vdc	3.5A
		Max. 90 Vdc	7A for 10 secs.
220V 1 phase	Continuous	125 Vdc	3.5A
		Max. 180 Vdc	7A for 10 secs.
220V 3 phase	Continuous	150 Vdc	3.5A
		Max. 215 Vdc	7A for 10 secs.
Resistance	\geq 18 ohms @ power input 110 Vac		
	\geq 36 ohms @ power input 220 Vac		
	Max. 100 ohms		
Fuse Spec.	Slow blow 5 x 20 mm S505-5A		

External Voltage Adjustment (VR1, VR2)

Max. +/- 5%	@ 500 ohms 1 watt potentiometer
Max. +/- 10%	@ 1K ohm 1 watt potentiometer

Voltage Regulation

Less than +/- 0.5% (with 4% engine governing)

Build Up Voltage

5 Vac 25 Hz residual volts at power input terminal

Soft Start Ramp Time

4 seconds +/- 10%

Typical System Response

Less than 20 milliseconds

EMI Suppression

Internal electromagnetic interference filtering

Static Power Dissipation

Max. 6 watts

Burden in SHUNT & PMG Wiring

550 VA @ power input 110 Vac
1100 VA @ power input 220 Vac

Quadrature Droop Input (C1, C2)

CT 1A or 5A greater than 5VA (DIP switch setting)
Sensitivity +/- 7% @ PF +/- 0.5 (Droop adjustable)

Analogue Voltage Input (A1, A2)

Input resistance greater than 2K ohms
Max. Input +/- 5 Vdc or +10 Vdc
Sensitivity 1 Vdc for 2.5% Generator Volts (adjustable)

Under Frequency Protection (Factory Presets)

50 Hz system presets knee point at 45 Hz
60 Hz system presets knee point at 55 Hz

Over Excitation Protection

Set point 125 Vdc +/- 4 % @ power input 220 Vac
Inverse-time curve. This function can be turned off.

Voltage Thermal Drift

Less than 3% at temperature range -40 to +70 °C

Under-Frequency Knee Point Thermal Drift

Less than +/- 0.1 Hz at -40 to +70 °C

Environment

Operating Temperature	-40 to +60 °C
Storage Temperature	-40 to +85 °C
Relative Humidity	Max. 95%
Vibration	5.5 Gs @ 60 Hz

Dimensions

150.0 (L) x 135.0 (W) x 55.5 (H) mm
5.91 (L) x 5.31 (W) x 2.19 (H) inch

Weight

460 g +/- 2%
1.01 lb +/- 2%

SECTION 2 : OUTLINE / SIZE / INSTALLATION REFERENCE


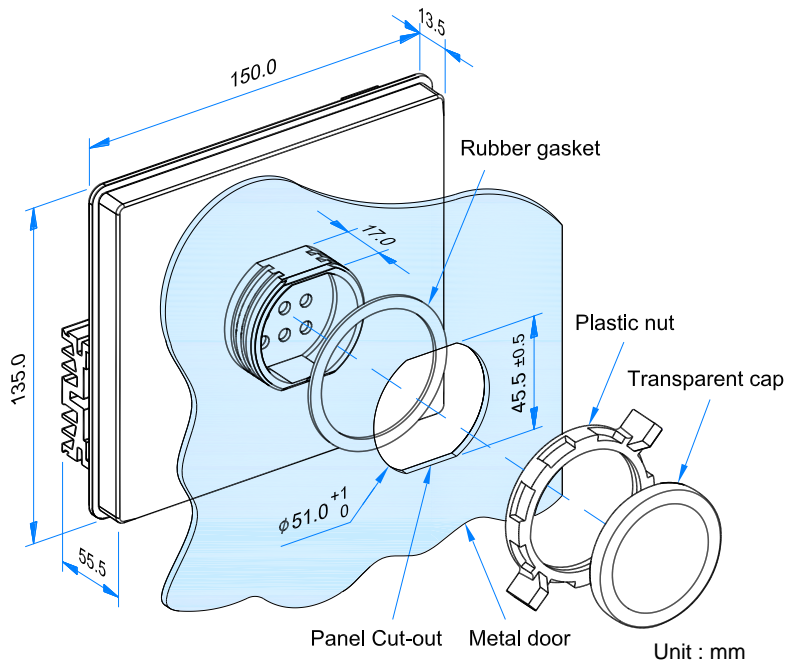


Figure 1 Outline Drawing

ATTENTION

1. AVR can be mounted directly on the engine, genset, switchgear, control panel, or any position that will not affect operation. For dimension reference, please see Figure 1.
2. All voltage readings are to be taken with an average-reading voltmeter Meggers and high-potential test equipment must not be used. Use of such equipment could damage the AVR.
3. Terminal : "Fast-On" terminals 6.35 mm (1/4 inch).
4. Improper setting of under-frequency protection could cause the output voltage of the unit to drop or become unstable under with changes in load. Avoid making any changes to the U/F setting unless necessary.
5. Turn off O/E in AVR when paralleling.

SECTION 3 : DIP SWITCH PROGRAMMING



REGULATOR SENSING VOLTAGE	REGULATOR STAB	FRAME SIZE
1.OFF 2.OFF 175-280 VAC	6.OFF 7.OFF <90KW	280-360
1.OFF 2.ON 380-480 VAC	6.ON 7.OFF 90-500KW	430
1.ON 2.ON 600 VAC	6.ON 7.ON >500KW	570

OFF	ON
3 3 PHASE (SENSING)	1 PHASE (SENSING)
4 60Hz	50Hz
5 O/E PROTECT ON	O/E PROTECT OFF
8 CT 1A	CT 5A

SW1
SW1 & SW2 Sets the Generators Sensing Voltage
SW3 Set Sensing Voltage for 1 or 3 Phase
SW4 Set Generator Frequency
SW5 Set Over Excitation Protection ON or OFF
SW6 & SW7 Sets Generator Capacity
SW8 Sets Capacity of Droop CT

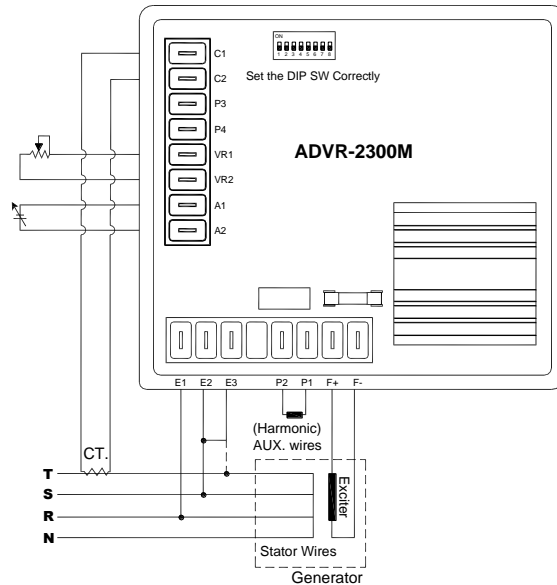


Figure 5 Auxiliary Winding (AUX.) Connection

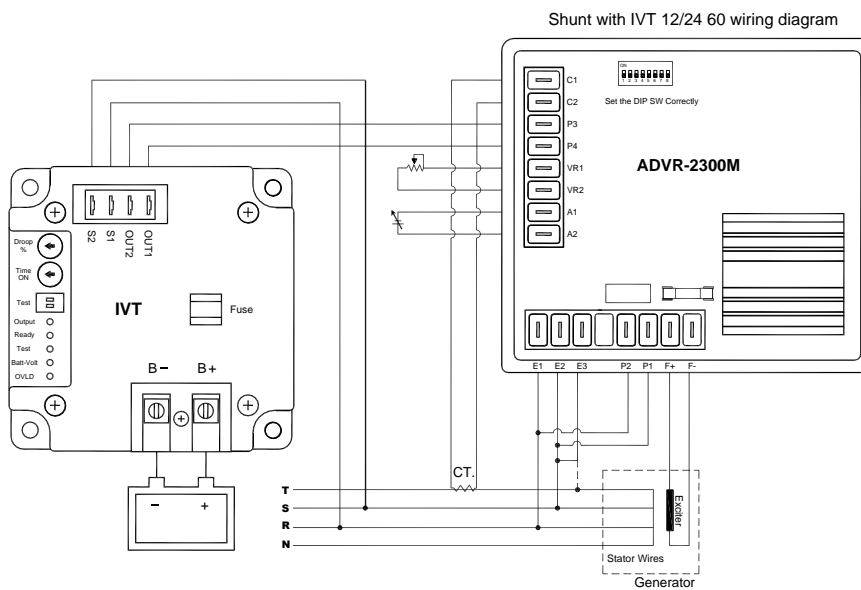


Figure 6 AVR-2300M & IVT-1260 / IVT-2460 Wiring Connection

ATTENTION

1. All AC voltage readings are Root Mean Square (RMS) value.
2. Use a remote 500 ohms 1 watt external VR for +/- 5% adjustment range. (keep shorted if not used)
3. Use a remote 1K ohm 1 watt external VR for +/- 10% adjustment range.
4. Sensing Voltage can be set from 220 – 600 Vac Program SW1 & SW2 correctly.
5. For single phase sensing bridge E2 & E3 and move SW3 to ON.
6. If your PMG is not working you can also power the AVR in shunt using terminals P1 & P2 connected to the output of the generator as long as it's less than 277 Vac.

- ※ Use only the replacement fuses specified in this user manual.
- ※ Appearance and specifications of products are subject to change for improvement without prior notice.